


PROFOMA FOR SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

No.

Dated:05.06.2025

It is Certified that an inspection team headed by **Smt. Mamatha H, Assistant Executive Engineer** from **Rural Drinking Water and Sanitation Sub Division Pandavapura** inspected the **Vidya Prachara Sangha, Pandavapura, Mandya District** on **Dt:04.06.2025** and found that the **Vijaya Higher Primary School(CBSE) Pandavapura** has safe drinking water facilities for the students and members of staff of the institution and is maintaining the hygienic sanitation condition in the school building & the campus as per norms prescribed by the Central/State/U.T. Govt.

The above is valid for a period of **5 Year**


Signature with Seal : **Asst. Executive Engineer**
Rural Drinking Water and
Sanitation Sub-Division,
Pandavapura
Name : **Smt. Mamatha H**
Designation : **Assistant Executive**
Engineer

Name & Address of the Office/Department : **Rural Drinking Water**
and Sanitation Sub Division Pandavapura

To,

The Secretary

Vidya Prachara Sangha®

Pandavapura, Mandya District-571434

Note: The Certificate is to be issued by Authorized officer/PHED Lab/ Local Bodies.

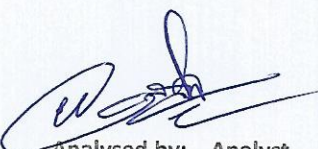



RURAL DRINKING WATER & SANITATION DEPARTMENT, GoK
Water Quality Testing Laboratory Sub Division, Pandavapura
PRED Building, Near Court Complex, Pandavapura -571434
e-mail: rdwsd.wqmSP.pandavapura@gmail.com

TEST REPORT

SAMPLE LOCATION : VIJAYA HIGHER PRIMARY SCHOOL (CBSE) PANDAVAPURA, MANDYA DIST			Date of Sample collection: 04.06.2025		
			Analysis start date: 04.06.2025		
			Analysis completion date: 05.06.2025		
			Sample collection protocol: APHA(23rd Edition)1060		
SCHEME: RO WATER			Sample quantity: 1 Ltr		
Sl.No	Test Parameter	Results	Acceptable Limit IS 10500 : 2012	Permissible Limit IS 10500 : 2012	Test Methods
1	Colour, Hazen Units	<1	5	15	IS 3025 (Part-4) :2021
2	Odour	Agreeable	Agreeable	Not Agreeable	IS-3025 (Part-5) :2018
3	pH Value @Temp	8.14 @ 25°C	6.5 – 8.5	No relaxation	IS 3025 (Part-11) : 2022
4	Turbidity, NTU	<0.5	1	5	IS 3025 (Part-10) : 2023
5	Specific Conductance, $\mu\text{S}/\text{cm}$ @ Temp	80.8 $\mu\text{S}/\text{cm}$ @ 25°C	–	–	IS 3025 (Part-14) : 2013
6	Total Dissolved Solids @180°C, mg/l	48	500	2000	IS 3025 (Part-16) : 2023
7	Alkalinity as CaCO_3 , mg/l	34.6	200	600	IS 3025 (Part-23) : 2023
8	Total Hardness as CaCO_3 , mg/l	38.2	200	600	IS 3025 (Part-21) : 2009
9	Calcium as Ca, mg/l	8.4	75	200	IS 3025 (Part-40) : 1991
10	Magnesium as Mg, mg/l	2.9	30	100	IS 3025 (Part-46) : 2023
11	Chloride as Cl, mg/l	2.4	250	1000	IS 3025 (Part-32) : 1988
12	Fluoride as F, mg/l	<0.1	1	1.5	APHA 23 rd Edition 4500-F:D
13	Sulphate as SO_4 , mg/l	0.4	200	400	IS 3025 (Part-24/Sec 1) : 2022
14	Nitrate as NO_3 , mg/l	<0.1	45	No relaxation	APHA 23 rd Edition 4500-NO3-B
15	Iron as Fe, mg/l	<0.1	1	No relaxation	IS 3025 (Part-53) : 2003

Remark: All the above Tested Parameter Conforms Acceptable Limit, As per IS 10500:2012 Specification.


Analysed by: Analyst


Assistant Executive Engineer
RDW&S Sub Division Pandavapura

RDWSD/WQMSP/TeR/01

Note:

- 1) The above results relate only to the sample tested.
- 2) The report shall not be reproduced except in full without the prior approval of the Quality Manager.
- 3) Traceability: Traceability of measurements is established using CRMs traceable to National/International standards
- 4) Samples will be discarded after 15 days from the date of report generation.
- 5) Decision rule is applicable as per the procedure mentioned in RDWSD/WQMSP/DR-01.